


**Burton Subdivision
Water Quality Testing Summary
Lewes Board of Public Works
Lewes, Delaware**

The Lewes Board of Public Works recently had water samples tested by a third party (Envirocorp Laboratories, Inc.) for their iron concentration from the area surrounding the Burton Subdivision including parts of W. 4th Street, Park Avenue, Burton Avenue, Johnson Avenue, Paynter Avenue, and DuPont Avenue (see image of test locations below – water meter sample locations are shown in yellow and fire hydrant sample location are shown in blue).

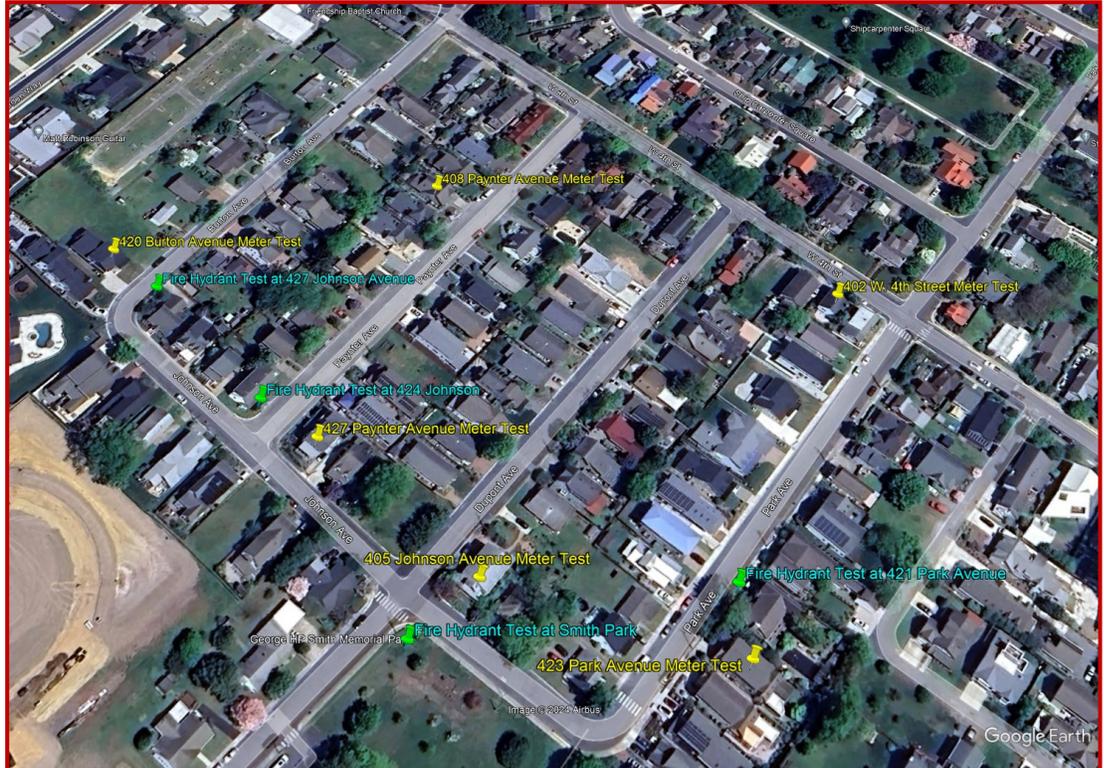

Six (6) samples were taken from existing water meters, and four (4) samples were taken from existing fire hydrants in the vicinity. The results of the Envirocorp Laboratories, Inc. iron concentration testing are summarized in the tables below.

The State of Delaware Secondary Maximum Contaminant Level (guidance level) is 0.3 milligrams per liter (mg/l). All six (6) BPW samples taken from water meters serving residences were significantly below the State maximum contaminant level.

Two (2) of the four (4) BPW samples taken from fire hydrants were below the State maximum contaminant level and two (2) were above the level. It is expected that water quality test results from a fire hydrant will have a higher iron concentration. When a hydrant is opened, the velocity of water is intentionally very high for fire-fighting purposes. The higher velocity of water will scour the pipes, picking up mineral deposits causing the water to be rust-colored and affecting the iron concentration measurement. The source of iron from the hydrants is naturally occurring from deposits in the iron pipes that make up the underground water distribution system.

**Burton Subdivision
 Water Quality Testing Summary
 Lewes Board of Public Works
 Lewes, Delaware**

<u>Water Meter Location</u>	State of Delaware Iron Secondary Maximum Contaminant Level	<u>Test Result</u>	<u>Type of Sample</u>	<u>Date of Sample and Testing</u>
427 Paynter Avenue	0.3 mg/l	0.0583 mg/l	Grab Sample at Water Meter	5/9/2024
402 W. 4th Street	0.3 mg/l	0.0266 mg/l	Grab Sample at Water Meter	5/9/2024
408 Paynter Avenue	0.3 mg/l	0.232 mg/l	Grab Sample at Water Meter	5/9/2024
420 Burton Avenue	0.3 mg/l	0.0575 mg/l	Grab Sample at Water Meter	5/9/2024
405 Johnson Avenue	0.3 mg/l	0.0362 mg/l	Grab Sample at Water Meter	5/9/2024
423 Park Avenue	0.3 mg/l	0.0448 mg/l	Grab Sample at Water Meter	5/9/2024

<u>Fire Hydrant Location</u>	State of Delaware Iron Secondary Maximum Contaminant Level	<u>Test Result</u>	<u>Type of Sample</u>	<u>Date of Sample and Testing</u>
Smith Park	0.3 mg/l	0.102 mg/l	Grab Sample at Fire Hydrant	5/9/2024
424 Johnson Avenue	0.3 mg/l	0.0636 mg/l	Grab Sample at Fire Hydrant	5/9/2024
421 Park Avenue	0.3 mg/l	5.87 mg/l	Grab Sample at Fire Hydrant	5/9/2024
427 Johnson Avenue	0.3 mg/l	3.46 mg/l	Grab Sample at Fire Hydrant	5/9/2024

Note: mg/l = milligrams per liter or parts per million



ENVIROCORP LABORATORIES INC.

51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER



May 13, 2024

Eric Wharton
City of Lewes (Drinking Water)
107 Franklin Street
Lewes, DE 19958

RE: Iron Testing

Enclosed are the results of analyses for samples received by our laboratory on 5/9/2024. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Rachael Short
Project Manager

Table of Contents

Cover Letter	1
Samples in Report	3
Case Narratives Work Order	4
Case Narratives Analyses	4
Sample Results	5
Qualifiers and Definitions	6
Chain of Custody PDF	7

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
 302-398-4313
 www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)	Project: Iron Testing
107 Franklin Street	Project Number: Iron Testing
Lewes, DE 19958	Reported: 05/13/2024 15:54

Sample Summary

Lab ID	Sample	Matrix	Sampled	Received
2404168-01	402 W. 4th St - Meter Pit	Drinking Water	5/9/2024 9:05	05/09/24 11:28

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)	Project: Iron Testing
107 Franklin Street	Project Number: Iron Testing
Lewes, DE 19958	Reported: 05/13/2024 15:54

TOC Case Narratives -

Case Narrative

Iron is a Secondary EPA Parameter.
EPA Secondary Limit is :0.30mg/L

Analysis Case Narrative

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
 302-398-4313
 www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)	Project: Iron Testing
107 Franklin Street	Project Number: Iron Testing
Lewes, DE 19958	Reported: 05/13/2024 15:54

Analytical Results

Sample ID: 402 W. 4th St - Meter Pit	Sample Start: 05/09/24 09:05
Lab ID: 2404168-01	
Matrix: Drinking Water	
Sample Type: Grab	Received: 05/09/24 11:28

Analyte	Result	Units	Reporting Limit	Qualifier	Method	Date Prepared	Date Analyzed	Analyst
---------	--------	-------	-----------------	-----------	--------	---------------	---------------	---------

Metals								
Iron	0.0266	mg/L	0.00100		EPA 200.7	5/10/24 10:45	5/10/24 12:28	JMW

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)

Project: Iron Testing

107 Franklin Street

Project Number: Iron Testing

Lewes, DE 19958

Reported: 05/13/2024 15:54

Notes and Definitions

Item	Definition
Dry-WT	Sample results reported on a dry weight basis.
ND	Analyte NOT DETECTED at or above the reporting limit.
Reporting Limit	Lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

#6



ENVIROCORP LABORATORIES INC.
51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorplabs.com
ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER MONITORING



Chain of Custody

Client: Eric Wharton
City of Lewes (Drinking Water)
107 Franklin Street
Lewes, DE 19958

Phone: 302-645-6512
Email: ewharton@lewesbpw.com

Comments: EI will add HNO3 to 8oz unpreserved at lab.

WORK ORDER #



2404168
City of Lewes (Drinking Water)
Iron Testing

Project: Iron Testing

Table with 4 columns: Container, Qty, Analysis, Comments. Row 1: Plastic - 8oz Unp, 1, Fe 200.7, [blank].

Sample #: 6 Address 402 W. 4th St Source Meter PIP Drinking Water Grab
Collection Date/Time: 5/9/24 0905 Collected By: EW

Relinquished By [Signature] Date/Time 5/9/24 0905 Received By [Signature] Date/Time 5/9/24 1128

Relinquished By _____ Date/Time _____ Received By _____ Date/Time _____



ENVIROCORP LABORATORIES INC.

51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER



May 13, 2024

Eric Wharton
City of Lewes (Drinking Water)
107 Franklin Street
Lewes, DE 19958

RE: Iron Testing

Enclosed are the results of analyses for samples received by our laboratory on 5/9/2024. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

A handwritten signature in black ink that reads 'Rachael Short'.

Rachael Short
Project Manager

Table of Contents

Cover Letter	1
Samples in Report	3
Case Narratives Work Order	4
Case Narratives Analyses	4
Sample Results	5
Qualifiers and Definitions	6
Chain of Custody PDF	7

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
 302-398-4313
 www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)	Project: Iron Testing
107 Franklin Street	Project Number: Iron Testing
Lewes, DE 19958	Reported: 05/13/2024 15:51

Sample Summary

Lab ID	Sample	Matrix	Sampled	Received
2404166-01	427 Johnson - Meter Pit	Drinking Water	5/9/2024 8:50	05/09/24 11:28

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)	Project: Iron Testing
107 Franklin Street	Project Number: Iron Testing
Lewes, DE 19958	Reported: 05/13/2024 15:51

(TOC - Case Narratives -

Case Narrative

Iron is a Secondary EPA Parameter.
EPA Secondary Limit is :0.30mg/L

Analysis Case Narrative

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)

Project: Iron Testing

107 Franklin Street

Project Number: Iron Testing

Lewes, DE 19958

Reported: 05/13/2024 15:51

Analytical Results

Sample ID: 427 Johnson - Meter Pit

Sample Start: 05/09/24 08:50

Lab ID: 2404166-01

Matrix: Drinking Water

Received: 05/09/24 11:28

Sample Type: Grab

Analyte	Result	Units	Reporting Limit	Qualifier	Method	Date Prepared	Date Analyzed	Analyst
Metals								
Iron	0.0583	mg/L	0.00100		EPA 200.7	5/10/24 10:45	5/10/24 12:14	JMW

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)

Project: Iron Testing

107 Franklin Street

Project Number: Iron Testing

Lewes, DE 19958

Reported: 05/13/2024 15:51

Notes and Definitions

Item	Definition
Dry-WT	Sample results reported on a dry weight basis.
ND	Analyte NOT DETECTED at or above the reporting limit.
Reporting Limit	Lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.



ENVIROCORP LABORATORIES INC.
51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorpplabs.com
ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER MONITORING



Chain of Custody

Client: Eric Wharton
City of Lewes (Drinking Water)
107 Franklin Street
Lewes, DE 19958

WORK ORDER #



2404166
City of Lewes (Drinking Water)
Iron Testing

Phone: 302-645-6512
Email: ewharton@lewesbpw.com

Comments: EI will add HNO3 to 8oz unpreserved at lab.

Project: Iron Testing

Table with 4 columns: Sample #, Address, Source, and Analysis. Includes handwritten entries for '427 JOHNSON', 'Meter pit', and 'Fe 200.7'. Also includes 'Drinking Water' and 'Grab' checkboxes, and 'Collection Date/Time' and 'Collected By' fields.

Relinquished By [Signature] Date/Time 5/19/24 0850
Relinquished By _____ Date/Time _____

Received By [Signature] Date/Time 5/8/24 1128
Received By _____ Date/Time _____

Temp. at Lab 8.9 Page 7 of 7



ENVIROCORP LABORATORIES INC.

51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER



May 13, 2024

Eric Wharton
City of Lewes (Drinking Water)
107 Franklin Street
Lewes, DE 19958

RE: Iron Testing

Enclosed are the results of analyses for samples received by our laboratory on 5/9/2024. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

A handwritten signature in black ink that reads 'Rachael Short'. The signature is written in a cursive, flowing style.

Rachael Short
Project Manager

Table of Contents

Cover Letter	1
Samples in Report	3
Case Narratives Work Order	4
Case Narratives Analyses	4
Sample Results	5
Qualifiers and Definitions	6
Chain of Custody PDF	7

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
 302-398-4313
 www.envirocorpplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)	Project: Iron Testing
107 Franklin Street	Project Number: Iron Testing
Lewes, DE 19958	Reported: 05/13/2024 15:54

Sample Summary

Lab ID	Sample	Matrix	Sampled	Received
2404167-01	408 Paynter - Meter Pit	Drinking Water	5/9/2024 8:58	05/09/24 11:28

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorpplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)

Project: Iron Testing

107 Franklin Street

Project Number: Iron Testing

Lewes, DE 19958

Reported: 05/13/2024 15:54

TOC Use Narratives -

Case Narrative

Iron is a Secondary EPA Parameter.
EPA Secondary Limit is :0.30mg/L

Analysis Case Narrative

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
 302-398-4313
 www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)	Project: Iron Testing
107 Franklin Street	Project Number: Iron Testing
Lewes, DE 19958	Reported: 05/13/2024 15:54

Analytical Results

Sample ID: 408 Paynter - Meter Pit **Sample Start:** 05/09/24 08:58
Lab ID: 2404167-01
Matrix: Drinking Water **Received:** 05/09/24 11:28
Sample Type: Grab

Analyte	Result	Units	Reporting Limit	Qualifier	Method	Date Prepared	Date Analyzed	Analyst
---------	--------	-------	-----------------	-----------	--------	---------------	---------------	---------

Metals								
Iron	0.232	mg/L	0.00100		EPA 200.7	5/10/24 10:45	5/10/24 12:21	JMW

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
 302-398-4313
 www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)	Project: Iron Testing
107 Franklin Street	Project Number: Iron Testing
Lewes, DE 19958	Reported: 05/13/2024 15:54

Notes and Definitions

Item	Definition
Dry-WT	Sample results reported on a dry weight basis.
ND	Analyte NOT DETECTED at or above the reporting limit.
Reporting Limit	Lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

#5



ENVIROCORP LABORATORIES INC.

51 CLARK STREET, HARRINGTON, DE 19952

302-398-4313

www.envirocorplabs.com

ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER MONITORING



Chain of Custody

WORK ORDER #



2404167
City of Lewes (Drinking Water)
Iron Testing

Client: Eric Wharton
City of Lewes (Drinking Water)
107 Franklin Street
Lewes, DE 19958

Phone: 302-645-6512
Email: ewharton@lewesbpw.com

Comments: EI will add HNO3 to 8oz unpreserved at lab.

Project: Iron Testing

Sample #: <u>5</u>	Address: <u>408 Painter</u>	Source: <u>Meter #17</u>	Drinking Water	Grab
Collection Date/Time: <u>5/9/24 0858</u>			Collected By: <u>EW</u>	
Container	Qty	Analysis	Comments	
Plastic - 8oz Unp	1	Fe 200.7		

[Signature]
Relinquished By
5/9/24 0858
Date/Time

[Signature]
Received By
5/9/24 1128
Date/Time

Relinquished By
Date/Time

Received By
Date/Time

Temp. at Lab
8.9



ENVIROCORP LABORATORIES INC.

51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER



May 13, 2024

Eric Wharton
City of Lewes (Drinking Water)
107 Franklin Street
Lewes, DE 19958

RE: Iron Testing

Enclosed are the results of analyses for samples received by our laboratory on 5/9/2024. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

Rachael Short
Project Manager

Table of Contents

Cover Letter	1
Samples in Report	3
Case Narratives Work Order	4
Case Narratives Analyses	4
Sample Results	5
Qualifiers and Definitions	6
Chain of Custody PDF	7

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
 302-398-4313
 www.envirocorpplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)	Project: Iron Testing
107 Franklin Street	Project Number: Iron Testing
Lewes, DE 19958	Reported: 05/13/2024 15:51

Sample Summary

Lab ID	Sample	Matrix	Sampled	Received
2404165-01	420 Burton - Meter Pit	Drinking Water	5/9/2024 8:45	05/09/24 11:28

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)	Project: Iron Testing
107 Franklin Street	Project Number: Iron Testing
Lewes, DE 19958	Reported: 05/13/2024 15:51

TOC - Case Narratives

Case Narrative

Iron is a Secondary EPA Parameter.
EPA Secondary Limit is :0.30mg/L

Analysis Case Narrative

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
 302-398-4313
 www.envirocorpplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)	Project: Iron Testing
107 Franklin Street	Project Number: Iron Testing
Lewes, DE 19958	Reported: 05/13/2024 15:51

Analytical Results

Sample ID: 420 Burton - Meter Pit **Sample Start:** 05/09/24 08:45
Lab ID: 2404165-01
Matrix: Drinking Water **Received:** 05/09/24 11:28
Sample Type: Grab

Analyte	Result	Units	Reporting Limit	Qualifier	Method	Date Prepared	Date Analyzed	Analyst
---------	--------	-------	-----------------	-----------	--------	---------------	---------------	---------

Metals

Iron	0.0575	mg/L	0.00100		EPA 200.7	5/10/24 10:45	5/10/24 12:07	JMW
------	--------	------	---------	--	-----------	---------------	---------------	-----

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)

Project: Iron Testing

107 Franklin Street

Project Number: Iron Testing

Lewes, DE 19958

Reported: 05/13/2024 15:51

Notes and Definitions

Item	Definition
Dry-WT	Sample results reported on a dry weight basis.
ND	Analyte NOT DETECTED at or above the reporting limit.
Reporting Limit	Lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

02110
#3



ENVIROCORP LABORATORIES INC.
51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorplabs.com
ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER MONITORING



Chain of Custody

Client: Eric Wharton
City of Lewes (Drinking Water)
107 Franklin Street
Lewes, DE 19958

WORK ORDER #



2404165
City of Lewes (Drinking Water)
Iron Testing

Phone: 302-645-6512
Email: ewharton@lewesbpw.com

Comments: EI will add HNO3 to 8oz unpreserved at lab.

Project: Iron Testing

Sample #: 3 **Address:** 420 Buxton **Source:** Meter Pit **Drinking Water** **Grab**
Collection Date/Time: 5/9/24 0845 **Collected By:** EW

Container	Qty	Analysis	Comments
Plastic - 8oz Unp	1	Fe 200.7	

G. [Signature]
Relinquished By 5/9/24 0845
Date/Time

[Signature]
Received By 5/9/24 1128
Date/Time

Relinquished By _____
Date/Time _____

Received By _____
Date/Time _____



ENVIROCORP LABORATORIES INC.

51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER



May 13, 2024

Eric Wharton
City of Lewes (Drinking Water)
107 Franklin Street
Lewes, DE 19958

RE: Iron Testing

Enclosed are the results of analyses for samples received by our laboratory on 5/9/2024. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

A handwritten signature in black ink that reads 'Rachael Short'.

Rachael Short
Project Manager

Table of Contents

Cover Letter	1
Samples in Report	3
Case Narratives Work Order	4
Case Narratives Analyses	4
Sample Results	5
Qualifiers and Definitions	6
Chain of Custody PDF	7

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
 302-398-4313
 www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)	Project: Iron Testing
107 Franklin Street	Project Number: Iron Testing
Lewes, DE 19958	Reported: 05/13/2024 15:46

Sample Summary

Lab ID	Sample	Matrix	Sampled	Received
2404164-01	405 Johnson - Meter Pit	Drinking Water	5/9/2024 8:30	05/09/24 11:28

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)	Project: Iron Testing
107 Franklin Street	Project Number: Iron Testing
Lewes, DE 19958	Reported: 05/13/2024 15:46

(TOC - Case Narratives -

Case Narrative

Iron is a Secondary EPA Parameter.
EPA Secondary Limit is :0.30mg/L

Analysis Case Narrative

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
 302-398-4313
 www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)	Project: Iron Testing
107 Franklin Street	Project Number: Iron Testing
Lewes, DE 19958	Reported: 05/13/2024 15:46

Analytical Results

Sample ID: 405 Johnson - Meter Pit **Sample Start:** 05/09/24 08:30
Lab ID: 2404164-01
Matrix: Drinking Water **Received:** 05/09/24 11:28
Sample Type: Grab

Analyte	Result	Units	Reporting Limit	Qualifier	Method	Date Prepared	Date Analyzed	Analyst
Metals								
Iron	0.0362	mg/L	0.00100		EPA 200.7	5/10/24 10:45	5/10/24 12:00	JMW

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
 302-398-4313
 www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)	Project: Iron Testing
107 Franklin Street	Project Number: Iron Testing
Lewes, DE 19958	Reported: 05/13/2024 15:46

Notes and Definitions

Item	Definition
Dry-WT	Sample results reported on a dry weight basis.
ND	Analyte NOT DETECTED at or above the reporting limit.
Reporting Limit	Lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.

#2



ENVIROCORP LABORATORIES INC.

51 CLARK STREET, HARRINGTON, DE 19952

302-398-4313

www.envirocorplabs.com

ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER MONITORING



Chain of Custody

Client: Eric Wharton
City of Lewes (Drinking Water)
107 Franklin Street
Lewes, DE 19958

Phone: 302-645-6512
Email: ewharton@lewesbpw.com

WORK ORDER #



2404164
City of Lewes (Drinking Water)
Iron Testing

Comments: EI will add HNO3 to 8oz unpreserved at lab.

Project: Iron Testing

Sample #: 2 **Address:** 405 Johnson **Source:** Meter Pit **Drinking Water** **Grab**
Collection Date/Time: 5/9/24 0830 **Collected By:** EW

Container	Qty	Analysis	Comments
Plastic - 8oz Unp	1	Fe 200.7	

E. Wharton
Relinquished By 5/9/24 0830
Date/Time

[Signature]
Received By 5/9/24 1128
Date/Time

Relinquished By _____
Date/Time _____

Received By _____
Date/Time _____

8.9
Temp. at Lab



ENVIROCORP LABORATORIES INC.

51 CLARK STREET, HARRINGTON, DE 19952

302-398-4313

www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER



May 13, 2024

Eric Wharton
City of Lewes (Drinking Water)
107 Franklin Street
Lewes, DE 19958

RE: Iron Testing

Enclosed are the results of analyses for samples received by our laboratory on 5/9/2024. If you have any questions concerning this report, please feel free to contact me.

Sincerely,

A handwritten signature in black ink that reads 'Rachael Short'. The signature is written in a cursive, flowing style.

Rachael Short
Project Manager

Table of Contents

Cover Letter	1
Samples in Report	3
Case Narratives Work Order	4
Case Narratives Analyses	4
Sample Results	5
Qualifiers and Definitions	6
Chain of Custody PDF	7

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
 302-398-4313
 www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)	Project: Iron Testing
107 Franklin Street	Project Number: Iron Testing
Lewes, DE 19958	Reported: 05/13/2024 15:41

Sample Summary

Lab ID	Sample	Matrix	Sampled	Received
2404163-01	423 Park Ave - Meter Pit	Drinking Water	5/9/2024 8:10	05/09/24 11:28

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)

Project: Iron Testing

107 Franklin Street

Project Number: Iron Testing

Lewes, DE 19958

Reported: 05/13/2024 15:41

(TOC) Case Narratives -

Case Narrative

Iron is a Secondary EPA Parameter.
EPA Secondary Limit is :0.30mg/L

Analysis Case Narrative

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
 302-398-4313
 www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)	Project: Iron Testing
107 Franklin Street	Project Number: Iron Testing
Lewes, DE 19958	Reported: 05/13/2024 15:41

Analytical Results

Sample ID: 423 Park Ave - Meter Pit **Sample Start:** 05/09/24 08:10
Lab ID: 2404163-01
Matrix: Drinking Water **Received:** 05/09/24 11:28
Sample Type: Grab

Analyte	Result	Units	Reporting Limit	Qualifier	Method	Date Prepared	Date Analyzed	Analyst
---------	--------	-------	-----------------	-----------	--------	---------------	---------------	---------

Metals								
Iron	0.0448	mg/L	0.00100		EPA 200.7	5/10/24 10:45	5/10/24 11:52	JMW

ENVIROCORP LABORATORIES INC.



51 CLARK STREET, HARRINGTON, DE 19952
302-398-4313
www.envirocorplabs.com



ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER

City of Lewes (Drinking Water)

107 Franklin Street

Lewes, DE 19958

Project: Iron Testing

Project Number: Iron Testing

Reported: 05/13/2024 15:41

Notes and Definitions

Item	Definition
Dry-WT	Sample results reported on a dry weight basis.
ND	Analyte NOT DETECTED at or above the reporting limit.
Reporting Limit	Lowest concentration value that meets project requirements for quantitative data with known precision and bias for a specific analyte in a specific matrix.



ENVIROCORP LABORATORIES INC.

51 CLARK STREET, HARRINGTON, DE 19952

302-398-4313

www.envirocorpplabs.com

ANALYTICAL SERVICES: NPDES, RCRA, GROUND WATER MONITORING



Chain of Custody

Client: Eric Wharton
City of Lewes (Drinking Water)
107 Franklin Street
Lewes, DE 19958

Phone: 302-645-6512

Email: ewharton@lewesbpw.com

WORK ORDER #



2404163

City of Lewes (Drinking Water)

Iron Testing

Comments: EI will add HNO3 to 8oz unpreserved at lab.

Project: Iron Testing

Table with columns: Sample #, Address, Source, Collection Date/Time, Container, Qty, Analysis, Drinking Water, Grab, Collected By, Comments. Includes handwritten entries for sample 1, address 423 Park Ave, source Meter Pit, collection date 0810 5/9/24, container Plastic - 8oz Unp, analysis Fe 200.7, and collector EW.

Relinquished By [Signature] Date/Time 0810 5/9/24

Received By [Signature] Date/Time 5/9/24 1128

Relinquished By _____ Date/Time _____

Received By _____ Date/Time _____